


Number of Months of Simulated Water Supply Cutbacks for the 1965 – 2000 Simulation Period

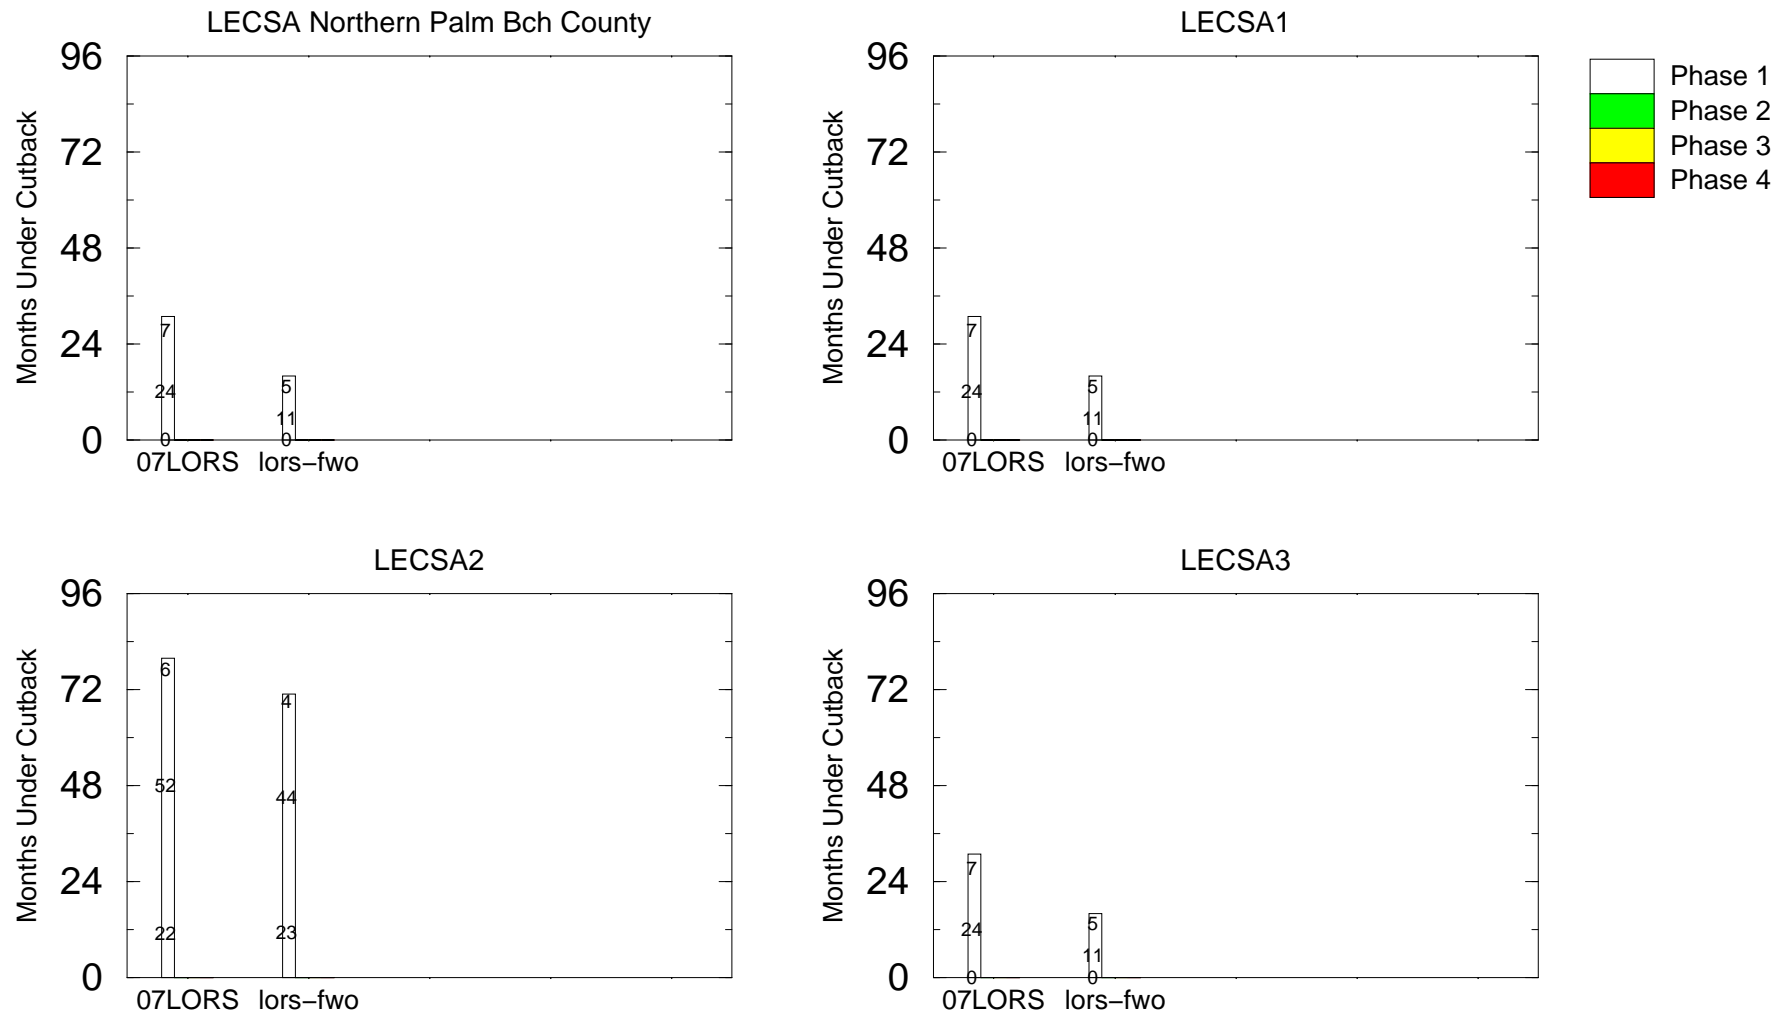

Note: Phase 1 water restrictions could be induced by a) Lake stage in Supply Side Management Zone (indicated by upper data label), For Planning Purposes Only
b) Local Trigger well stages (lower data label), and c) Dry season criteria (indicated by middle data label).
Run date: 06/05/06 21:27:27

SFWMM V5.5.2

Script used: lec_cutbacks_mon_bar.scr, V1.2

Filename: lec_cutbacks_mon_bar.fig